

Republic of the Philippines

Indang, Cavite, Philippines


(046) 889-6373


www.cvsu.edu.ph


INVITATION TO SUBMIT TENDER

University of Cavite State (UCVS) invites interested firms/supplier to submit quotation

for the purchase of the following items:

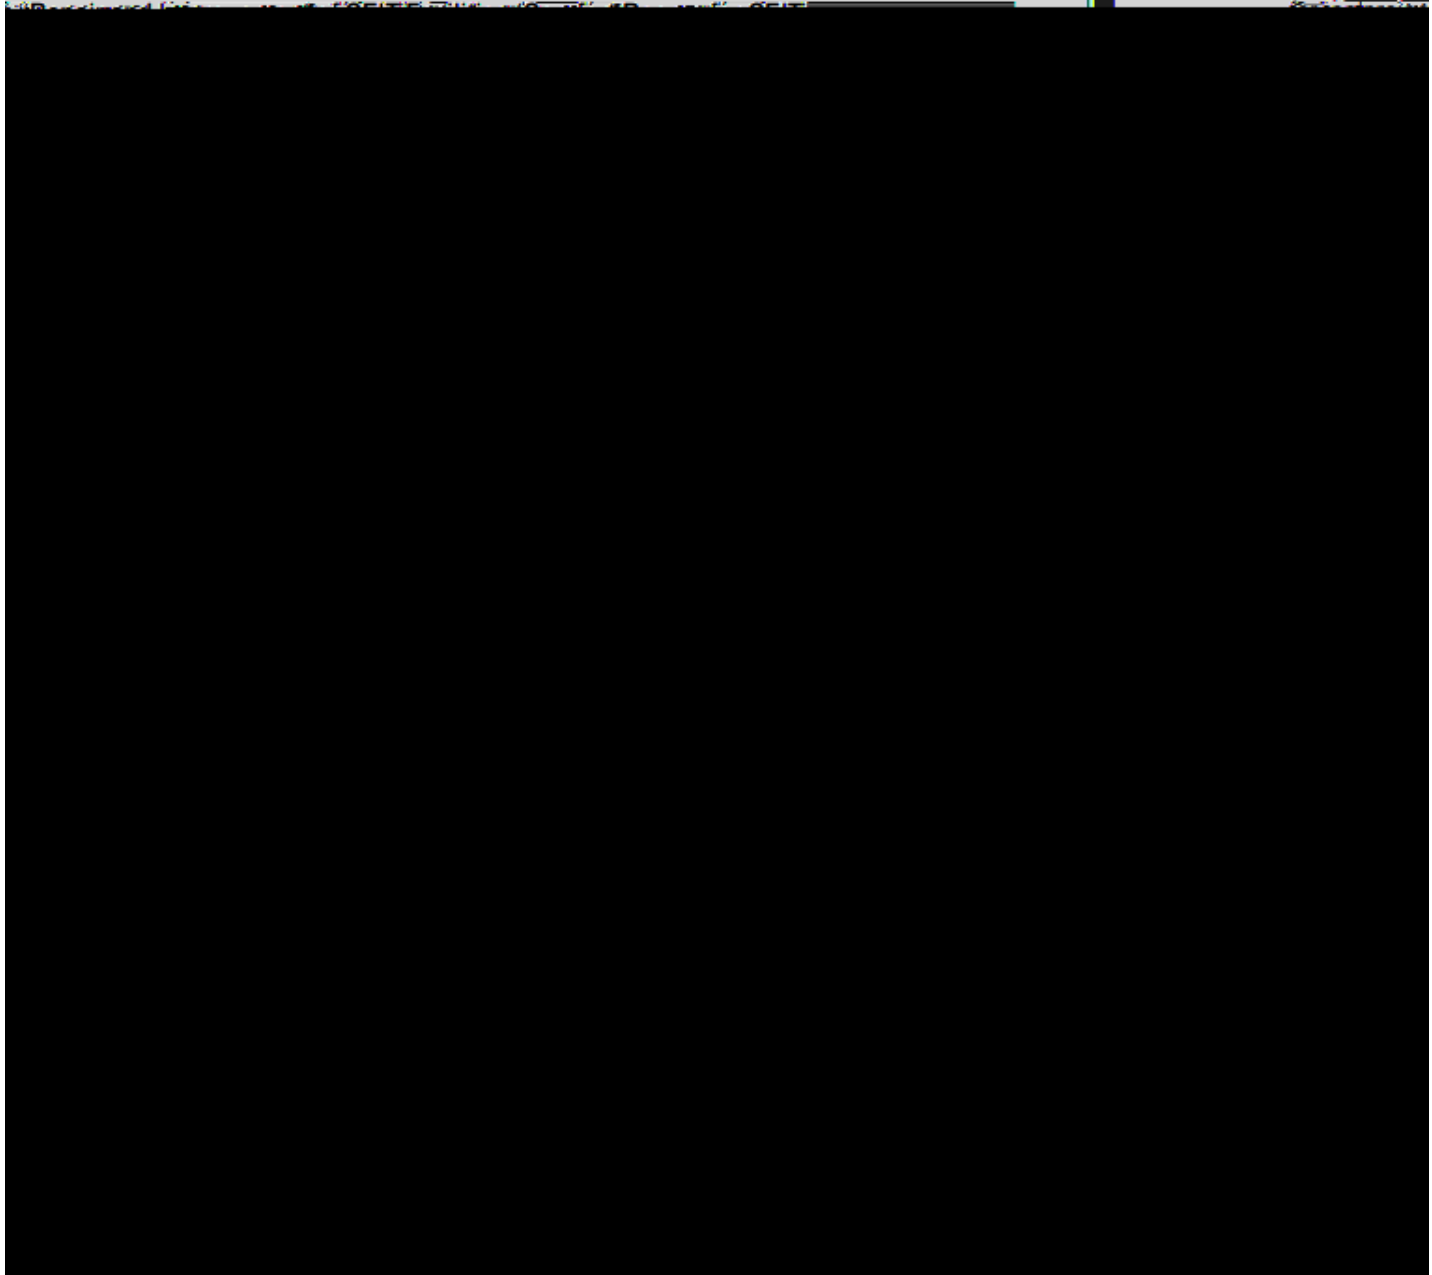

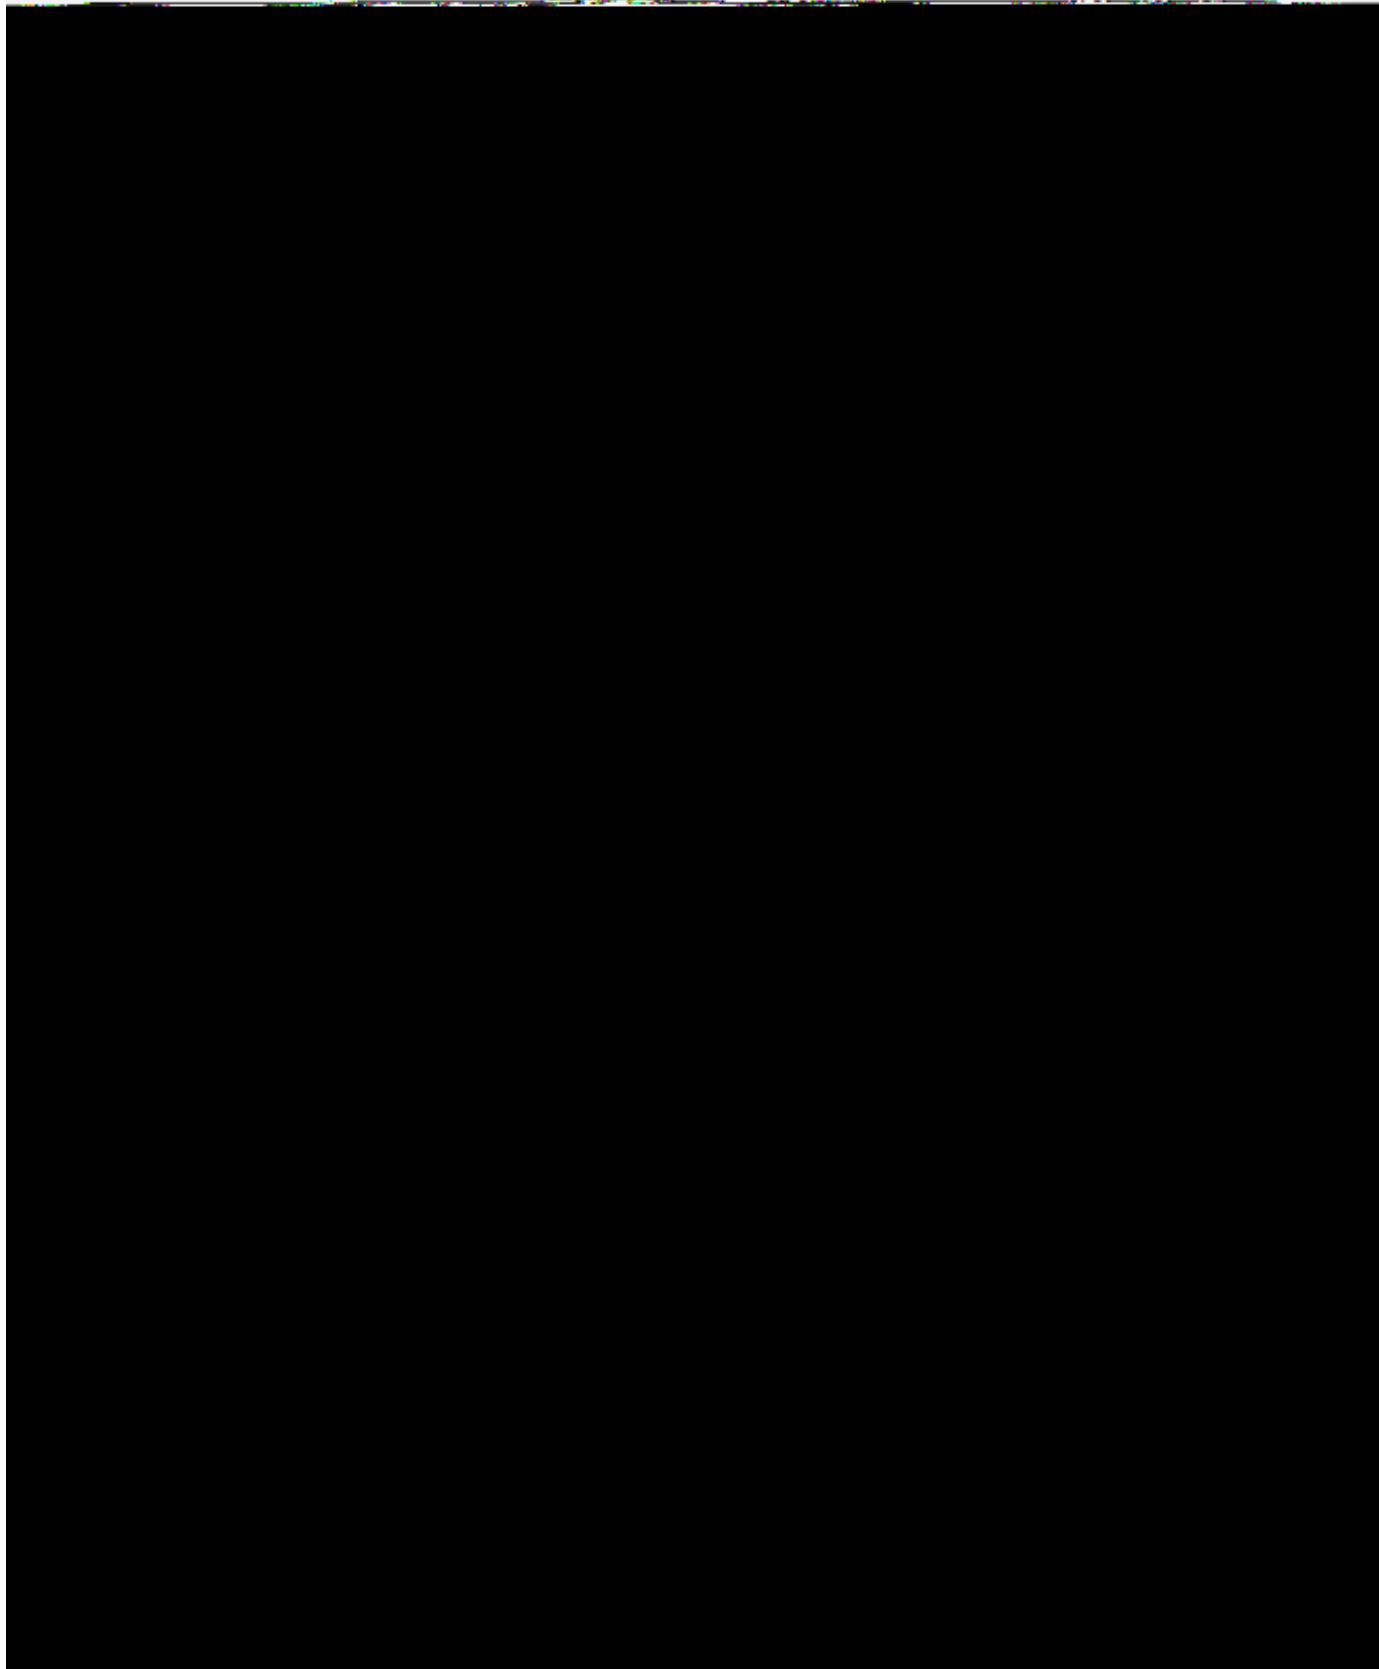



at 2015 and complete with all accessories.

FOR DIT BUILDING

1. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

2. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

3. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

4. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

5. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

6. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

7. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

FOR DIT BUILDING

8. For DIT building, supply and installation of the following:

- e. PVC orange pipe and fitting 100mm dia with 100mm x 100mm x 100mm elbow
- f. Braided drain (2 unit)
- g. Pinlight with LED lamp 11W (4 unit), provide adjustment on wiring for pinlight and switch replacement.

WORK.

